


PRIMARY LINE CLEARANCE
TYPICAL

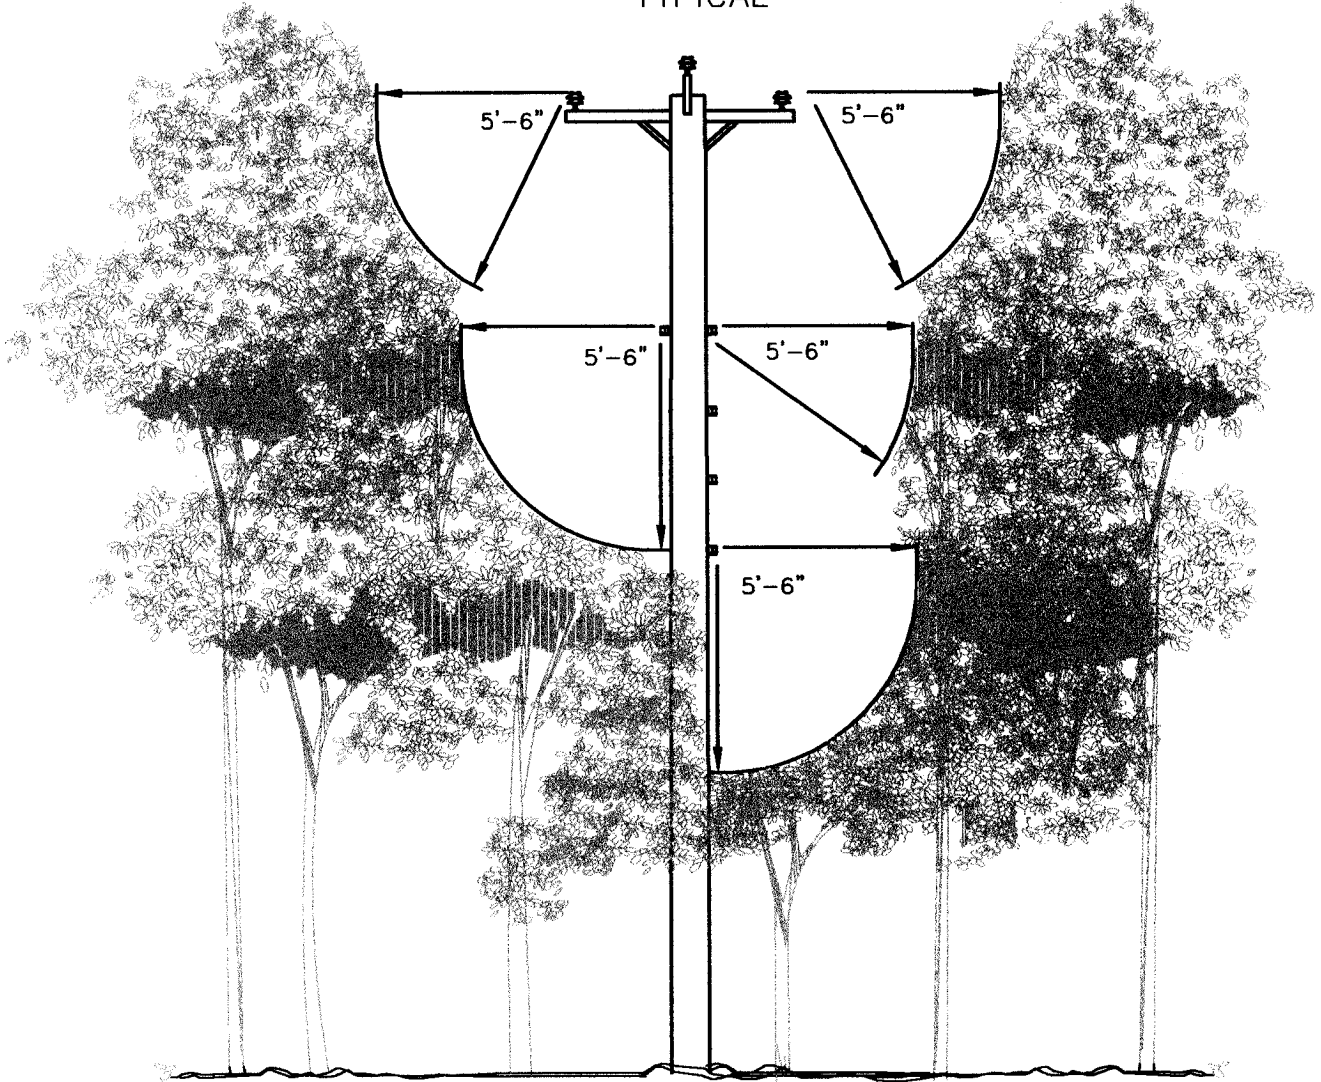

SECONDARY LINE CLEARANCE
TYPICAL

DRAWN BY: JC	DATE: 4/28/05	APPROVED BY: CP
REVISED BY:	DATE:	APPROVED BY:

TITLE:
DISTRIBUTION LINE
TREE CLEARANCE

GARLAND
POWER & LIGHT
STANDARD NO.:
OH-908