


ENGINEERING NOTE:

- NEUTRAL MAY BE INSTALLED AT 60" TO MEET EXISTING FIELD CONDITIONS
- CAN BE USED WITH SHORT SPANS AS AN ANGLE POLE BY INSTALLING THE RIDGE PIN ON THE BACKSIDE OF THE POLE AS SHOWN.

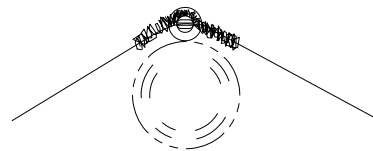

ANGLE CONSTRUCTION

TITLE:

SINGLE PHASE INLINE

GARLAND
POWER & LIGHT

DRAWN BY: DATE: APPROVED BY:

GL 3-17-04

REVISED BY: DATE: APPROVED BY:

CY/JC 1/28/15

STANDARD NO.:

OH-1270

Construction Standard No.

OH-1270

Title: SINGLE PHASE INLINE

Rev. Date: 1/12/2015

Pic #	Description	IBM NO.	Qty
1	PIN POLE TOP, FIBERGLASS, CONTINENTAL GRP-58M-21, 1" THREADS	285-21-13825	1
2	INSULATOR PIN TYPE 15KV	286-42-25100	1
3	INSULATOR SPOOL TYPE SECONDARY	286-42-23310	1
4	1 PT RACK GALV 1-1/2" X 1/2" X 1/8" CLEVIS	285-39-14039	1
5	BOLT MACHINE 5/8" X 12" W/ NUT	285-08-10786	1
6	BOLT MACHINE 5/8" X 14" W/ NUT	285-08-10788	2
7	WASHER SQUARE 5/8" 250/BX	285-08-15320	3
8	WASHER SPRING DOUBLE COIL 5/8" 500/BX	285-08-85430	3

Garland Power & Light



OH-1270